

Flow Measurement

SITRANS F M

System information SITRANS F M Electromagnetic flowmeters

Benefits



Greater flexibility

- Wide product program
- Compact or remote installation using the same transmitter and sensor
- USM II communication platform for easy integration with all systems

Easier commissioning of MAG 5000, 6000, 6000 I

All SITRANS F M pulsed DC electromagnetic flowmeters feature a unique SENSORPROM memory unit which stores sensor calibration data and transmitter settings for the lifetime of the product.

At commissioning the flowmeter commences measurement without any initial programming.

The factory settings matching the sensor size are stored in the SENSORPROM unit. Also customer specified settings are downloaded to the unit. Should the transmitter be replaced, the new transmitter will upload all previous settings and resume measurement without any need for reprogramming.

Further, the „fingerprint“ used in connection with the SITRANS F M Vericator is stored during the initial sensor calibration.

Easier service

Transmitter replacement requires no programming. SENSORPROM automatically updates all settings after initialization.

Room for growth

USM II the Universal Signal Module with "plug & play" simplicity, makes it easy to access and integrate the flow measurement with almost any system and bus-protocol and it ensures the flowmeter will be easy to upgrade to future communication/bus platforms.

Application

Electromagnetic flowmeters are suitable for measuring the flow of almost all electrically conductive liquids, pastes and slurries.

A prerequisite is that the medium must have a minimum conductivity. The temperature, pressure, density and viscosity have no influence on the result.

The main applications of the electromagnetic flowmeters can be found in the following sectors:

- Water and waste water
- Chemical industries
- Pharmaceutical industries
- Food and beverage industry
- Mining, aggregates and cements industries
- Pulp and paper industry
- Steel industry
- Power; utility and chilled water industry

The wide variety of combinations and versions from the modular system means that ideal adaptation is possible to each measuring task.

Flow Measurement

SITRANS F M

System information SITRANS F M Electromagnetic flowmeters

Please see product selector on the Internet, because some constraints might be related to some of the features:

www.pia-portal.automation.siemens.com



MAG 1100	MAG 1100 HT	MAG 1100 F	MAG 3100	MAG 3100 HT	MAG 3100 P	MAG 5100 W		911/E	MAG8000/ MAG 8000 CT	MAG 8000 Irrigation
7ME6110	7ME6120	7ME6140	7ME6310	7ME6320	7ME6340	7ME6520	7ME6580	7ME5610	7ME6810 7ME6820	7ME6880

Industry

Water / waste water	XX			XX		X	XXX	XXX	X	XXX ¹⁾	XXX ¹⁾
Chemical	XXX	XXX	XX	XXX	XXX	XXX	X	X		X	
Pharmaceutical	XX	XX	XXX	XX	XX	XX	X	X		X	
Food and beverage	XX		XXX	X	X	X	X	X		X	
Mining, aggregates and cement	XX			XXX			X	X	XXX	X	
HPI	XX	X		XX	X	XX	X	X		X	
Other	XX	XX	XX	XX	XX	XX	XX	XX	XXX	X	

Design

Compact	•		•	•	•	•	•	•		•	•
Remote	•	•	•	•	•	•	•	•	•	•	•
Constant field (DC)	•	•	•	•	•	•	•	•		•	•
Alternating field (AC)									•		
Battery-operated constant field (DC)										•	•

Size

DN 2 (1/12")	•										
DN 3 (1/8")	•										
DN 6 (1/4")	•										
DN 10 (3/8")	•		•								
DN 15 (1/2")	•	•	•	•	•	•	•		•		
DN 25 (1")	•	•	•	•	•	•	•	•	•	•	
DN 32 (1 1/4")			• ²⁾								
DN 40 (1 1/2")	•	•	•	•	•	•	•	•	•	•	
DN 50 (2")	•	•	•	•	•	•	•	•	•	•	•
DN 65 (2 1/2")	•	•	•	•	•	•	•	•	•	•	•
DN 80 (3")	•	•	•	•	•	•	•	•	•	•	•
DN 100 (4")	•	•	•	•	•	•	•	•	•	•	•
DN 125 (5")				•	•	•	•	•	•	•	•
DN 150 (6")				•	•	•	•	•	•	•	•
DN 200 (8")				•	•	•	•	•	•	•	•
DN 250 (10")				•	•	•	•	•	•	•	•
DN 300 (12")				•	•	•	•	•	•	•	•
DN 350 (14")				•			•	•	•	•	•
DN 400 (16")				•			•	•	•	•	•
DN 450 (18")				•			•	•	•	•	•
DN 500 (20")				•			•	•	•	•	•
DN 600 (24")				•			•	•	•	•	•
DN 700 (28")				•			•	•	•	•	
DN 750 (30")				•			•	•	•	•	
DN 800 (32")				•			•	•	•	•	
DN 900 (36")				•			•	•	•	•	
DN 1000 (40")				•			•	•	•	•	
DN 1050 (42")				•			•	•		•	
DN 1100 (44")				•			•	•		•	
DN 1200 (48")				•			•	•		•	

• = available, X = can be used, XX = often used, XXX = most often used

¹⁾ Not suitable for wastewater applications

²⁾ Only in combination with DN 32 adapter A5E02054637, A5E02218297, FDK:083G2120 and FDK:083G2160

Flow Measurement

SITRANS F M

System information SITRANS F M Electromagnetic flowmeters

Please see product selector on the Internet, because some constraints might be related to some of the features:

www.pia-portal.automation.siemens.com



MAG 1100	MAG 1100 HT	MAG 1100 F	MAG 3100	MAG 3100 HT	MAG 3100 P	MAG 5100 W	911/E	MAG8000/ MAG 8000 CT	MAG 8000 Irrigation	
7ME6110	7ME6120	7ME6140	7ME6310	7ME6320	7ME6340	7ME6520	7ME6580	7ME5610	7ME6810 7ME6820	7ME6880

Size (continued)

DN 1400 (54")				●				●		
DN 1500 (60")				●				●		
DN 1600 (66")				●				●		
DN 1800 (72")				●				●		
DN 2000 (78")				●				●		

Process connection

Water design	●	●								
Sanitary process connections			●							
Flanges				●	●	●	●	●	●	● ²⁾

Flange norms

EN 1092-1				●	●	●	●	●	●	● ²⁾
ANSI B 16.5 class 150				●	●	●	●	●	●	● ²⁾
ANSI B 16.5 class 300				●	●			●		
ASME B 16.47 class 150				●						
AWWA class D				●			●	●	●	
AS 2129				●	●					● ²⁾
AS 4087, PN 16				●	●		●	●	●	
AS 4087, PN 21				●	●					
AS 4087, PN 35				●	●					
JIS 10K				●			●	●		
JIS 20K				●						

Pressure rating¹⁾

PN 6				●				●		
PN 10				●	●	●	●	●	●	
PN 16	●		●	●	●	●	●	●	●	
PN 25				●	●			●		
PN 40	●	●	●	●	●	●	●	●	●	
PN 63				●						
PN 100				●						

Accuracy

Flow error ± 0.2 % of rate	●	●	●	●	●	●	●	●	●	
Flow error ± 0.4 % of rate	●	●	●	●	●	●	●	●	●	
Flow error ± 0.5 % of rate								●		
Flow error ± 0.8 % of rate										●

Repeatability⁴⁾

0.1 %	●	●	●	●	●	●	●	●	●	●
0.2 %								●		

Grounding electrodes, incl.

●³⁾

●³⁾

●

●

(●)

●

Grounding rings premounted from factory

●

● = available

¹⁾ Pressure may be limited by the liner material chosen

²⁾ Drilled pattern flange max. 7 bar (107 psi).

³⁾ Optional on PFA

⁴⁾ Of actual flow for $v \geq 0.5$ m/s (1.5 ft/s) and conductivity $> 10 \mu\text{S/cm}$

System information SITRANS F M Electromagnetic flowmeters

Please see product selector on the Internet, because some constraints might be related to some of the features:

www.pia-portal.automation.siemens.com



MAG 1100	MAG 1100 HT	MAG 1100 F	MAG 3100	MAG 3100 HT	MAG 3100 P	MAG 5100 W		911/E	MAG 8000/ MAG 8000 CT	MAG 8000 Irrigation
7ME6110	7ME6120	7ME6140	7ME6310	7ME6320	7ME6340	7ME6520	7ME6580	7ME5610	7ME6810 7ME6820	7ME6880

Materials/temperature:Liner material/max. temperatures

NBR Hard Rubber: 70 °C (158 °F)

EPDM: 70 °C (158 °F)

Soft rubber: 70 °C (158 °F)

PTFE: 100 °C (212 °F)

PTFE: 130 °C (266 °F)

PTFE: 180 °C (356 °F)

Ebonite Hard Rubber: 95 °C (203 °F)

Linatex: 70 °C (158 °F)

Ceramic: 150 °C (302 °F)

Ceramic: 200 °C (392 °F)

PFA: 100 °C (212 °F)

PFA: 150 °C (302 °F)

Novolak: 130 °C (266 °F)

Electrodes

Stainless steel

Hastelloy C

Platinum

Titanium

Tantalum

Flange/housing material

Carbon steel

Stainless steel / carbon steel

Polished stainless steel

ApprovalsCustody transfer

Cold water - MI-001 (EU)

Cold water approval - OIML R 49/OIML R 49 MAA

NMI 10 (Australia)

Chilled water pattern approval PTB K 7.2

OE12/C 040 (Austria)

Chilled water pattern approval

KIWA water approval

Marine

ABS

Bureau Veritas

DNV

GL

Lloyd's Register

● = available

¹⁾ 150 °C (302 °F)

²⁾ Ex sensor: 180 °C (356 °F)

³⁾ 70 °C (158 °F)

⁴⁾ For verification submit Product Variation Request (PVR)

Flow Measurement

SITRANS F M

System information SITRANS F M Electromagnetic flowmeters

Please see product selector on the Internet, because some constraints might be related to some of the features:

www.pia-portal.automation.siemens.com



MAG 1100	MAG 1100 HT	MAG 1100 F	MAG 3100	MAG 3100 HT	MAG 3100 P	MAG 5100 W		911/E	MAG 8000/ MAG 8000 CT	MAG 8000 Irrigation
7ME6110	7ME6120	7ME6140	7ME6310	7ME6320	7ME6340	7ME6520	7ME6580	7ME5610	7ME6810 7ME6820	7ME6880

Approvals (continued)

Hazardous areas

ATEX - 2 GD (Zone 1/21)	•	•	•	•	•	•				
IECEX Zone 1/21				•	•	•				
FM Class I/II/III, Div 1				• ⁸⁾	• ⁸⁾	• ⁸⁾				
FM Class I, Zone 1/21				•	•	•				
FM Class I, Div 2	•	•	•	•	•	•	•	•		
FM Class I, Zone 2	•	•	•	•	•	•	•	•		
CSA Class I, Zone 1/21				•	•	•				
CSA Class I, Div 2				•	•	•	•	•		
NEPSI Zone 1				•	•	•				
EAC Ex	•	•	•	•	•	•				

Hygienic

EHEDG			•							
3A			•							
EC 1935:2004 European food contact material			•							

Drinking water

WRAS (WRc) - (GB)				•		• ⁴⁾	•		•	•
ANSI/NSF 61 (US) ⁷⁾				• ⁴⁾		•	•		•	•
ACS (FR) EPDM liner				•		•			•	
Belgaqua (B) EPDM liner				•		•			•	
DVGW-W270 (D) EPDM liner				•		•			•	
KIWA (NL) EPDM liner						•				
MCERTS (GB environmental)				• ⁵⁾		• ³⁾			•	

Other

CRN (Canada)	• ⁹⁾			•	•	•	•	•	•	
FM Fire Service (class number 1044)							• ⁶⁾		• ⁶⁾	
EAC (Russia, Belarus and Kazakhstan)	•	•	•	•	•	•	•	•	•	
CMC/CPA (China)				•			•			•
PED 97/23 EC	•	•	•	•	•	•	•	•	•	
VdS							• ²⁾			

Vericator compatible

• = available

- 1) Only in combination with MAG 5000 and MAG 6000 transmitters.
- 2) Only valid for DN 50 to DN 300 (2" to 12")
- 3) EPDM liner
- 4) Only EPDM with Hastelloy electrodes
- 5) EPDM or PTFE liner with AISI 316 or Hastelloy electrodes.

- 6) Sizes: DN 50, DN 80, DN 100, DN 150, DN 200, DN 250, and DN 300 (2", 3", 4", 6", 8", 10", and 12") with ANSI B16.5 Class 150 flanges
- 7) Including Annex G
- 8) Only DN 15 to DN 300 (½" to 12") with MAG 6000 I Ex, compact mounted
- 9) Only PFA liner

System information SITRANS F M Electromagnetic flowmeters

Please see Product selector on the Internet, because some constraints might be related to some of the features:

www.pia-portal.automation.siemens.com



	MAG 5000	MAG 6000	MAG 6000 I	MAG 6000 I Ex	MAG 6000 + Ex Safety barrier	TRANSMAG 2	MAG 8000/ MAG 8000 CT	MAG8000 Irrigation
	7ME6910	7ME6920	7ME6930	7ME6930	7ME6920	7ME5034	7ME6810 7ME6820	7ME6880
Industry								
Water / waste water	XXX	XXX	XX	X		X	XXX	XXX
Chemical	X	XX	XX	XXX	X		X	
Pharmaceutical	X	XXX	XX	XXX	X		X	
Food and beverage	XX	XXX	XX				X	
Mining, aggregates and cement	XX	X	XX	X		XXX	X	
HPI	X	X	X	XX			X	
Other	XX	XX	XX	XX		XX	X	
Design								
Compact	●	●	●	●			●	●
Remote	●	●	●	●	●	●	●	●
Constant field (DC)	●	●	●	●	●		●	●
Alternating field (AC)						●		
Battery-operated constant field (DC)							●	●
Enclosure transmitter								
Polyamide, IP67	●	●						
Die-cast aluminum			●	●		●		
Stainless steel		●					● ¹⁾	● ¹⁾
19" rack	●	●			●			
Front panel mounting	●	●			●			
Panel mounting	●	●			●			
IP66 wall mounting	●	●	●	●	●			
Accuracy								
Flow error ± 0.2 % of rate		●	●	●	●		●	
Flow error ± 0.4 % of rate	●						●	
Flow error ± 0.5 % of rate						●		
Flow error ± 0.8 % of rate								●
Repeatability³⁾								
0.1 %	●	●	●	●	●		●	●
0.2 %						●		
Communication								
HART	●	●	●	●	●	●		
PROFIBUS PA		●	●	●	●	●		
PROFIBUS DP		●	●		●			
FOUNDATION Fieldbus H1		●	●	●	●			
DeviceNet		●	●		●			
Modbus RTU/RS 485		●	●		●		● ²⁾	● ²⁾
Encoder interface module (Sensus protocol) for Itron 200WP radio							●	●
GSM/GPRS module							●	
Batching		●	●	●	●			

● = available, X = can be used, XX = often used, XXX = most often used

¹⁾ IP68 enclosure

²⁾ Modbus RTU also as serial RS 232

³⁾ Of actual flow for $v \geq 0.5$ m/s (1.5 ft/s) and conductivity $> 10 \mu\text{S/cm}$

Flow Measurement

SITRANS F M

System information SITRANS F M Electromagnetic flowmeters

Please see Product selector on the Internet, because some constraints might be related to some of the features:

www.pia-portal.automation.siemens.com



MAG 5000	MAG 6000	MAG 6000 I	MAG 6000 I Ex	MAG 6000 + Ex Safety barrier	TRANSMAG 2	MAG 8000/ MAG 8000 CT	MAG8000 Irrigation
7ME6910	7ME6920	7ME6930	7ME6930	7ME6920	7ME5034	7ME6810 7ME6820	7ME6880

Power supply

24 V	● ¹⁾	● ¹⁾	●	●		● ^{1) 2)}	● ^{1) 2)}
115 V - 230 V	●	●	●	●	●	● ²⁾	● ²⁾
Battery						●	

Approvals

Custody transfer

Cold water - MI-001 (EU)	●	●				●	
Cold water approval - OIML R 49/OIML R 49 MAA						●	
Chilled water pattern approval PTB K 7.2	● ⁵⁾	● ⁵⁾				● ⁵⁾	
OE12/C 040 (Austria)	●	●					
Chilled water pattern approval							
KIWA water approval		●				●	

Marine

ABS	●	●					
Bureau Veritas	●	●					
DNV	●	●					
GL	●	●					
Lloyd's Register	●	●					

Hazardous areas

ATEX - 2 GD (Zone 1/21)				●	(●) ³⁾		
IECEx Gb Zone 1/21				●			
FM Class I/II/III, Div 1				● ⁴⁾			
FM Class I, Zone 1/21				●			
FM Class I, Div 2	●	●	●				
FM Class I, Zone 2	●	●	●				
CSA Class I, Zone 1/21				●			
CSA Class I, Div 2	●	●	●				
UL / C-UL- general safety	●	●			●		
NEPSI Zone 1				●			
EAC Ex				●	●		

Other

FM Fire Service (1044)	●	●				●	
C - tick (Australia)	●	●	●	●	●		
EAC (Russia, Belarus and Kazakhstan)	●	●	●	●	●	●	
CMC/CPA (China)	●	●	●	●			●
VdS	●	●					
Other national approvals, see internet	●	●	●	●	●	●	●

Verificator compatible

- = available
- ¹⁾ 12/24 V AC/DC
- ²⁾ Main power with battery backup
- ³⁾ Only sensor in hazardous area
- ⁴⁾ Only with sensors sizes DN 15 to DN 300 (1/2" to 12") compact
- ⁵⁾ For verification submit Product Variation Request (PVR)

For more national approvals please check our internet page
<http://support.automation.siemens.com/WW/view/en/10806954/134200>

Practical examples of ordering

SITRANS F M compact installation




Example

Sensor	7ME6310-3TC11-1JA1
Pipe size	DN 100
Liner	Soft rubber
Electrodes	SS 316
Flanges	EN 1092-1, PN 16
Transmitter	MAG 6000, Polyamide, 115 ... 230 V AC
Accuracy	$\pm 0.2 \% \pm 1 \text{ mm/s}$
Supply	230 V AC

Note:

MAG 5000/6000 transmitters, sensors and communication modules are packed in separate boxes, the final assembly takes place during installation at the customer's place.

SITRANS F M remote installation

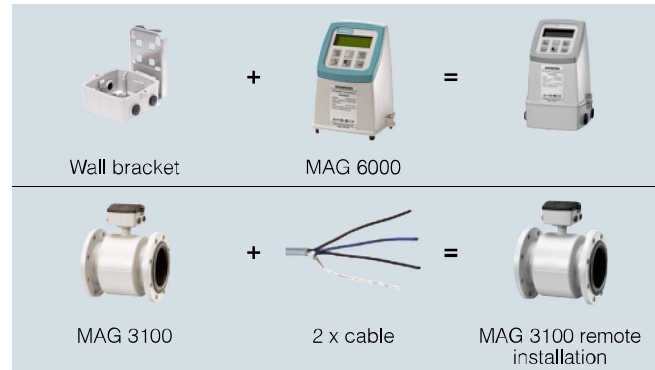

Example

Sensor	7ME6310-3TC11-1AA1
Pipe size	DN 100
Liner	Soft rubber
Electrodes	SS 316
Flanges	EN 1092-1, PN 16
Transmitter	7ME6920-1AA10-0AA0
Accuracy	$\pm 0.2 \% \pm 1 \text{ mm/s}$
Supply	230 V AC
Wall mounting kit	FDK:085U1018
Cable kit with sensor cable and electrode cable	A5E01181647

Flow Measurement

SITRANS F M

System information SITRANS F M Electromagnetic flowmeters

Technical specifications

Flowmeter Calibration and traceability

To ensure continuous accurate measurement, flowmeters must be calibrated. The calibration is conducted at Siemens flow facilities with traceable instruments referring directly to the physical unit of measurement according to the International System of Units (SI).

Therefore, the calibration certificate ensures recognition of the test results worldwide, including the US (NIST traceability).



Siemens offers accredited calibrations assured to ISO 17025 in the flow range from 0.0001 m³/h to 10 000 m³/h.

The calibration follows the ISO 4185 performing calibrations under two methods: Static Weighing and Reference meter. Providing a measurement uncertainty of $\pm 0.1\%$.

Siemens Flow Instruments accredited laboratories are recognized by ILAC MRA (International Laboratory Accreditation Corporation - Mutual Recognition Arrangement) ensuring international traceability and recognition of the test results worldwide.

A calibration certificate is shipped with every sensor and calibration data are stored in the SENSORPROM memory unit.

Flowmeter uncertainty

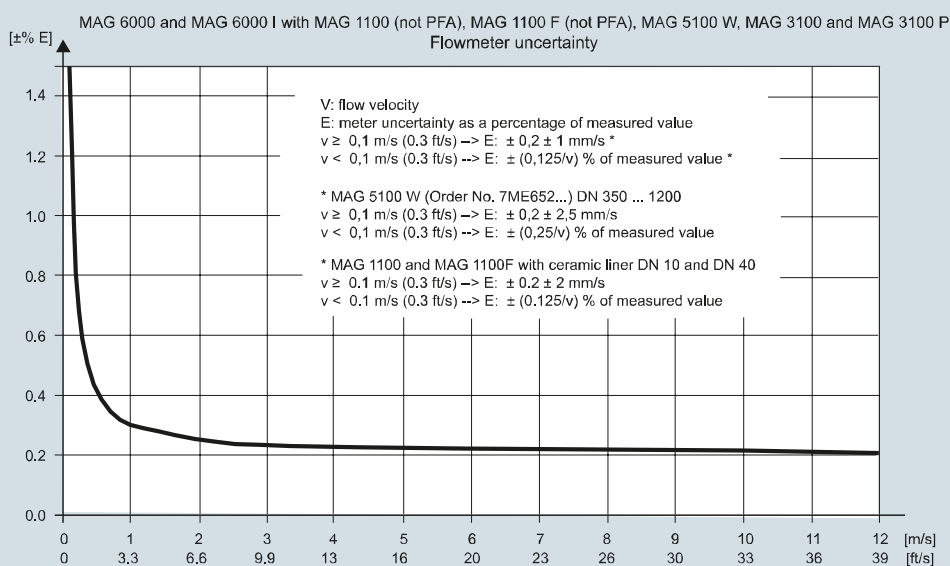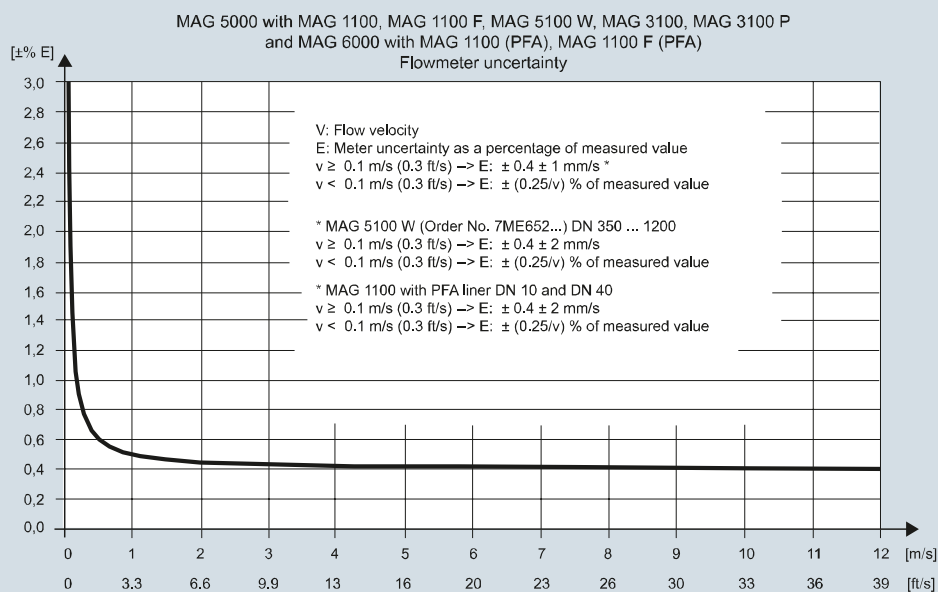

Calibration reference conditions**Reference conditions (ISO 9104 and DIN EN 29104)**

Temperature medium	20 °C ± 10 K (68 °F ± 18 °F)
Temperature ambient	25 °C ± 10 K (77 °F ± 18 °F)
Supply voltage	$U_n \pm 1\%$
Warming-up time	30 minutes
Incorporation in conductive pipe section	
• Inlet section	10 x DN (DN ≤ 1200/48") 5 x DN (DN > 1200/48")
• Outlet section	5 x DN (DN ≤ 1200/48") 3 x DN (DN > 1200/48")
Flow conditions	Developed flow profile

Additions in the event of deviations from reference conditions

Current output	As pulse output ($\pm 0.1\%$ of actual flow + 0.05 % FSO)
Effect of ambient temperature	
• Display / frequency / pulse output	$< \pm 0.003\% / K$ act.
• Current output	$< \pm 0.005\% / K$ act.
Effect of supply voltage	$< 0.005\%$ of measuring value on 1% change
Repeatability	$\pm 0.1\%$ of actual flow for $v \geq 0.5$ m/s (1.5 ft/s) and conductivity $> 10 \mu S/cm$

Certificates

• EN 10204-2.1	Certificate of conformity, stating that the delivered parts are made of the material quality that was ordered. Available as Z option C15.
• EN 10204-2.2	Test report certificate, a non batch specific material analysis of the ordered material. Available as Z option C14.
• EN 10204-3.1	Material analysis certificate, a batch specific analysis of the material issued by an independent inspector. Certification covers all pressure containing and wetted parts. Available as Z option C12.

Flow Measurement

SITRANS F M

System information SITRANS F M Electromagnetic flowmeters

Technical specifications

General specifications

PROFIBUS device profile	3.00 Class B
Certified	No
MS0 connections	1
MS1 connections	1
MS2 connections	2

Electrical specification DP

Physical layer specifications

Applicable standard	IEC 61158/EN 50170
Physical Layer (Transmission technology)	RS 485
Transmission speed	≤ 1.5 Mbits/s
Number of stations	Up to 32 per line segment, (maximum total of 126)

Cable specification (Type A)

Cable design	Two-wire twisted pair
Shielding	CU shielding braid or shielding braid and shielding foil
Impedance	35 up to 165 Ω at frequencies from 3 ... 20 MHz
Cable capacity	< 30 pF per meter
Core diameter	> 0.34 mm ² , corresponds to AWG 22
Resistance	< 110 Ω per km
Signal attenuation	Max. 9 dB over total length of line section
Max. bus length	200 m at 1500 kbit/s, up to 1.2 km at 93.75 kbit/s. Extendable by repeaters

Electrical specification PA

Physical layer specifications

Applicable standard	IEC 61158/EN 50170
Physical Layer (Transmission technology)	IEC-61158-2
Transmission speed	31.25 Kbits/second
Number of stations	Up to 32 per line segment, (maximum total of 126)
Max. basic current [I _B]	14 mA
Fault current [I _{FDE}]	0 mA
Bus voltage	9 ... 32 V (non Ex)

Preferred cable specification (Type A)

Cable design	Two-wire twisted pair
Conductor area (nominal)	0.8 mm ² (AWG 18)
Loop resistance	44 Ω/km
Impedance	100 Ω ± 20 %
Wave attenuation at 39 kHz	3 dB/km
Capacitive asymmetry	2 nF/km
Bus termination	Passive line termination at both
Max. bus length	Up to 1.9 km. Extendable by repeaters

IS (Intrinsic Safety) data

Required sensor electronics	Compact or remote mounted SITRANS F M MAG 6000 I Ex
FISCO	Yes
Max. U _I	17.5 V
Max. I _I	380 mA
Max. P _I	5.32 V
Max. L _I	0 μH
Max. C _I	0 nF

FISCO cable requirements

Loop resistance R _C	15 ... 150 Ω/km
Loop inductance L _C	0.4 ... 1 mH/km
Capacitance C _C	80 ... 200 nF/km
Max. Spur length in IIC and IIB	30 m
Max. Trunk length in IIC	1 km
Max. Trunk length in IIB	5 km

PROFIBUS parameter support

The following parameters are accessible using a MS0 relationship from a Class 1 Master. MS0 specifies cyclic Data Exchange between a Master and a Slave.

Cyclic services

Input (Master view)	Parameter	MAG 6000/MAG 6000 I
	Mass flow	
	Volume flow	✓
	Temperature	
	Density	
	Fraction A	
	Fraction B	
	Pct Fraction A	
	Totalizer 1	✓
	Totalizer 2 ¹⁾	✓
	Batch progress ¹⁾	✓
	Batch setpoint	✓
	Batch compensation	✓
	Batch status (running ...)	✓
Output (Master view)	Set Totalizer 1+2	✓
	Set Mode Totalizer 1+2	✓
	Batch control (start, stop ...)	✓
	Batch setpoint	✓
	Batch compensation	✓


¹⁾ Value returned is dependent on the BATCH function.

When ON, Batch progress is returned.

When OFF, TOTALIZER 2 is returned.

Flow and speed chart

Metric

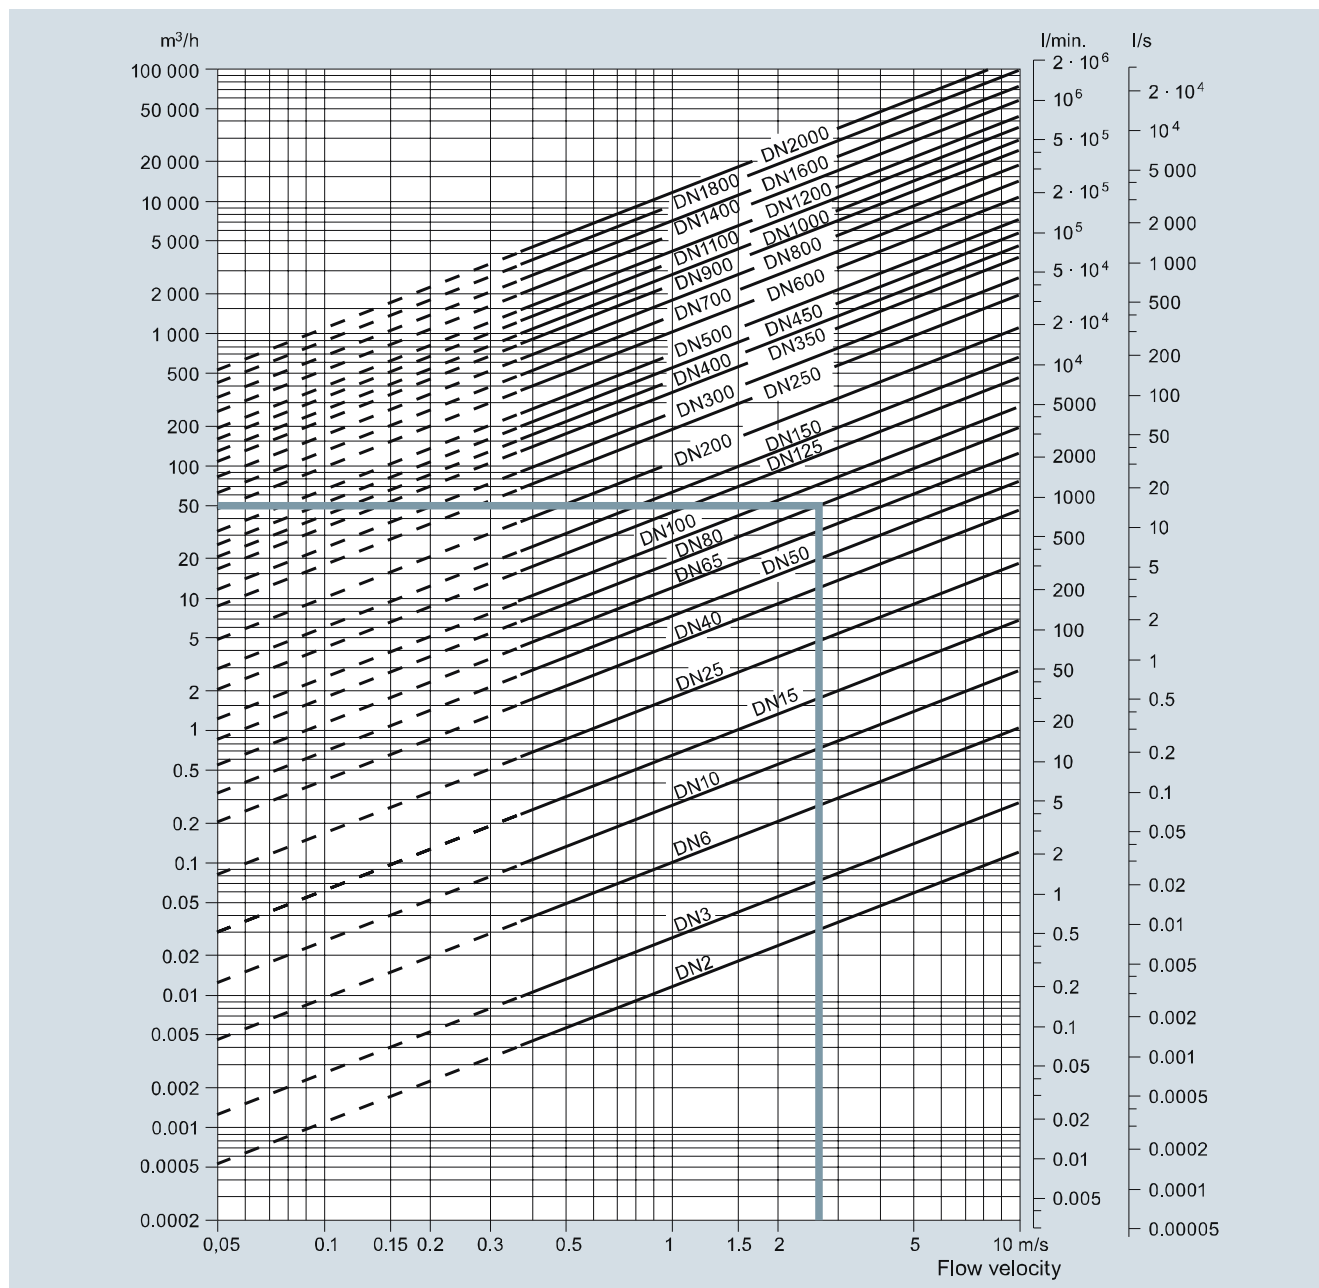

Sizing table (DN 2 ... DN 2000)

The table shows the relationship between flow velocity v , flow quantity Q and sensor dimension DN .

Guidelines for selection of sensor

Min. measuring range: 0 to 0.25 m/s

Max. measuring range: 0 to 10 m/s

Normally the sensor size is selected so that the nominal flow velocity v lies within the measuring range 1 to 3 m/s.

Example:

Flow quantity of 50 m³/h and a sensor dimension of DN 80 gives a flow velocity of 2.7 m/s, which is within the recommended measuring range of 1 to 3 m/s.

Flow velocity calculation formula Units

$$v = 1273.24 \cdot Q / DN^2 \text{ or}$$

$$v = 353.68 \cdot Q / DN^2$$

v : [m/s], Q : [l/s], DN : [mm]

v : [m/s], Q : [m³/h], DN : [mm]

Link to "Sizing program":


<https://pia.khe.siemens.com/index.aspx?nr=11501>

Flow Measurement

SITRANS F M

System information SITRANS F M Electromagnetic flowmeters

Imperial

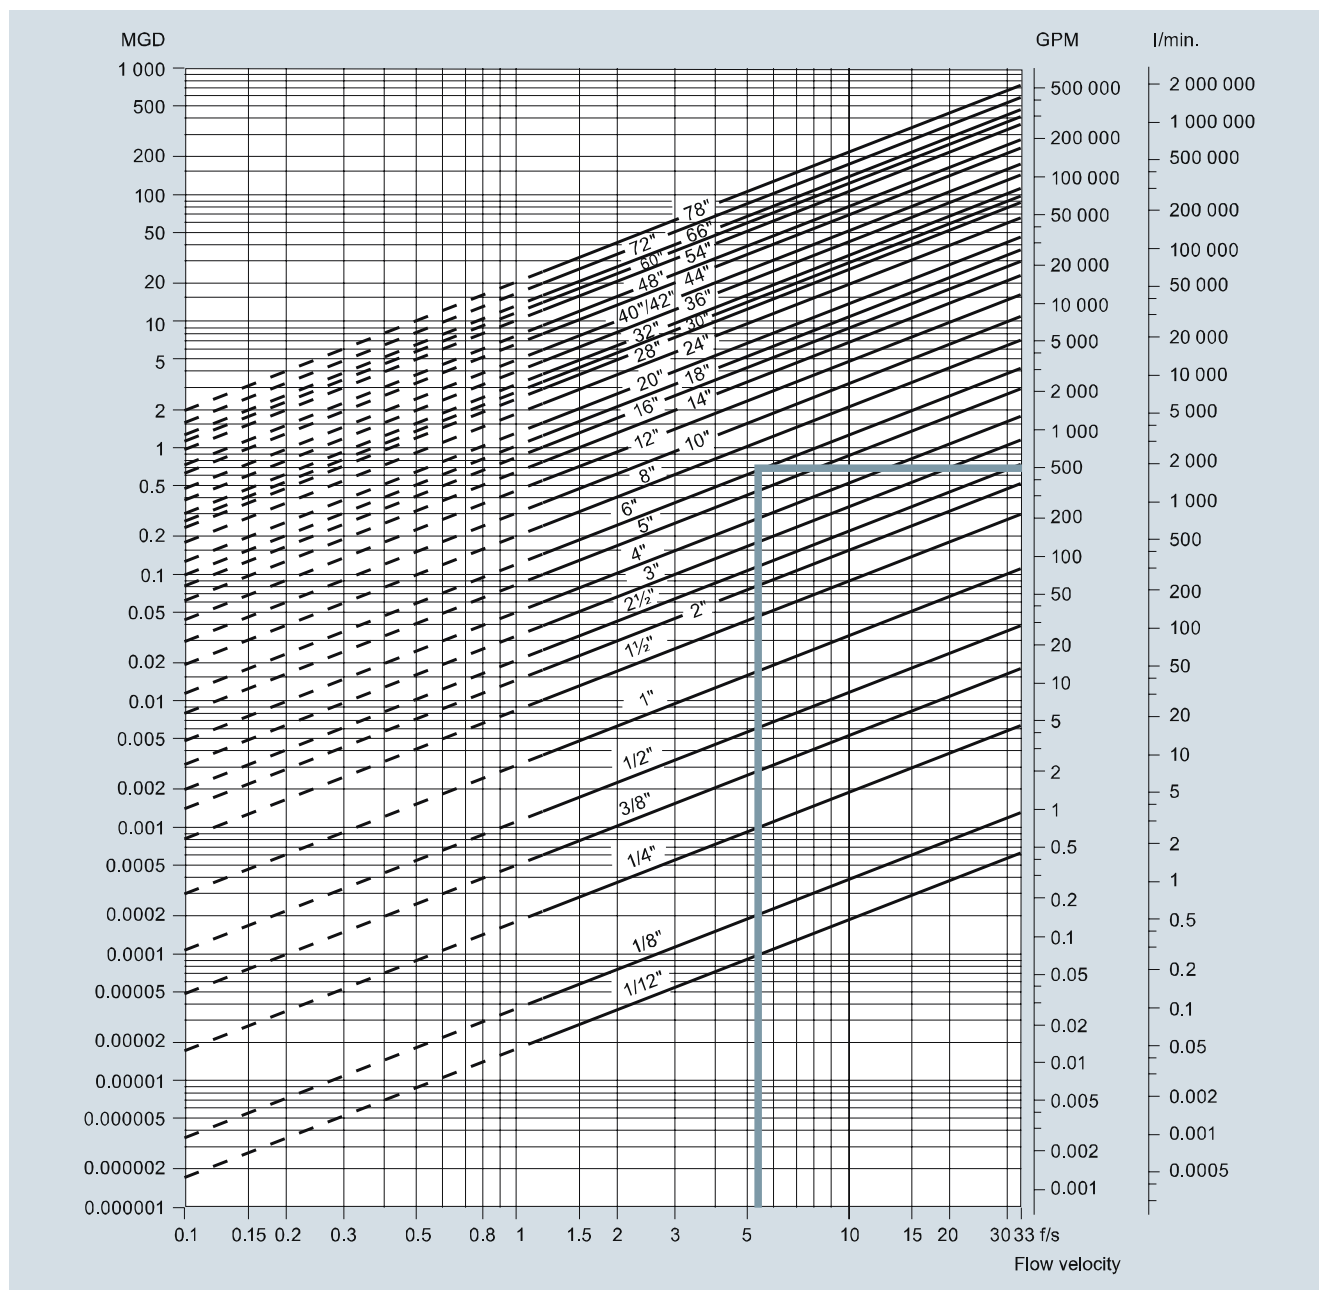

Sizing table ($1/12''$... 78'')

The table shows the relationship between flow velocity v , flow quantity Q and sensor dimension size.

Guidelines for selection of sensor

Min. measuring range: 0 to 0.8 ft/s

Max. measuring range: 0 to 33 ft/s

Normally the sensor size is selected so that the nominal flow velocity v lies within the measuring range 3 to 10 ft/s.

Example:

Flow quantity of 500 GPM and a sensor dimension of 6" gives a flow velocity of 5.6 ft/s, which is within the recommended measuring range of 3 to 10 ft/s.

Flow velocity calculation formula Units

$$v = 0.408 \cdot Q / (\text{Pipe I.D.})^2 \text{ or}$$

$$v = 283.67 \cdot Q / (\text{Pipe I.D.})^2$$

v : [ft/s], Q : [GPM], Pipe I.D. : [inch]

v : [ft/s], Q : [MGD], Pipe I.D. : [inch]


Link to "Sizing program":

<https://pia.khe.siemens.com/index.aspx?nr=11501>


System information SITRANS F M Electromagnetic flowmeters
Installation conditions
Vibrations

Strong vibrations should be avoided.

In applications with strong vibrations, remote mounting of the transmitter is recommended.

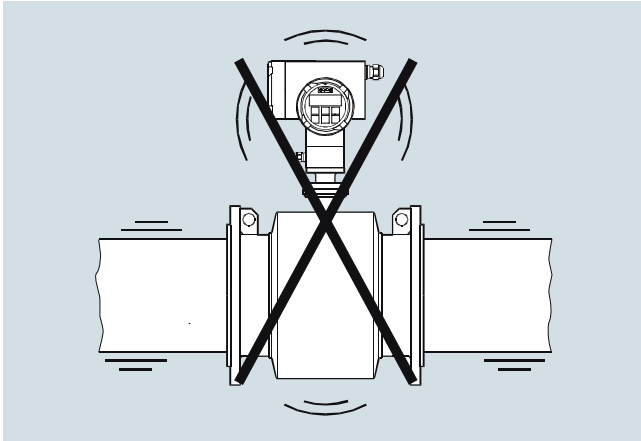



The sensor must always be completely filled with liquid.

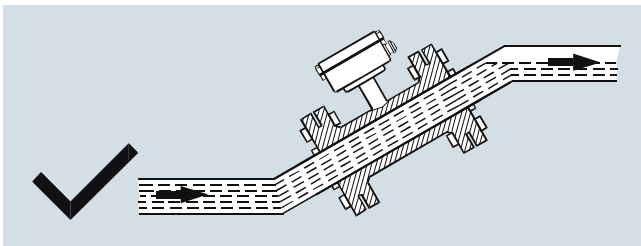

Install in pipelines which are always full


The sensor must always be completely filled with liquid. Therefore avoid:

- Installation at the highest point in the pipe system
- Installation in vertical pipes with free outlet

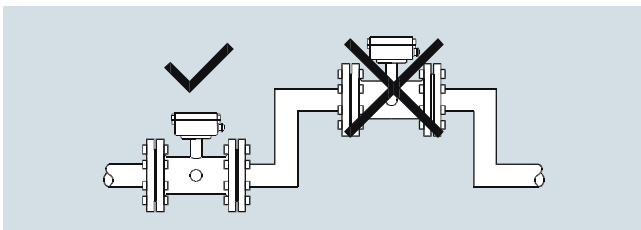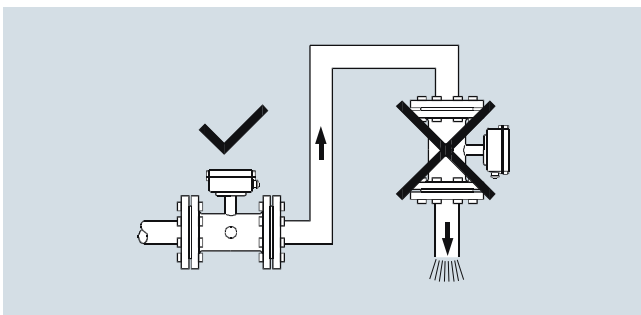

Do not install in pipelines which can run empty


For partially filled pipes or pipes with downward flow and free outlet the flowmeter should be located in a U-Tube.

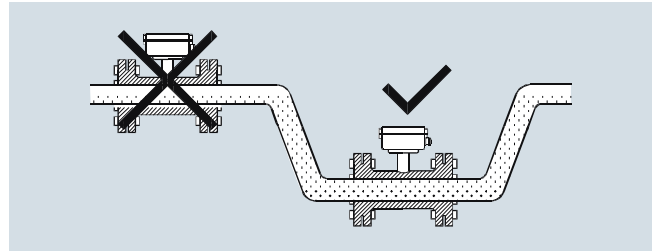

Install in U-tubes when pipe is partially filled

Installation in vertical pipes


Recommended flow direction: upwards. This minimizes the effect on the measurement of any gas/air bubbles in the liquid.

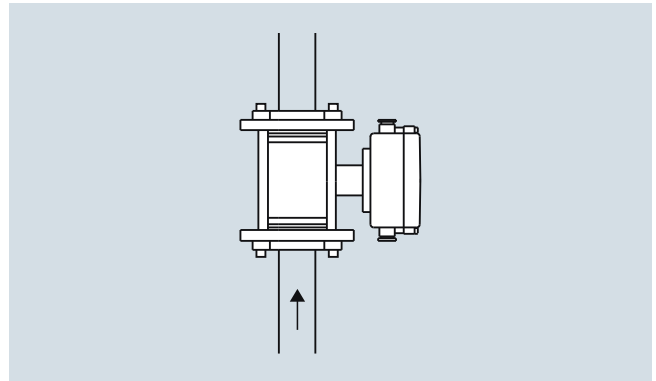

Install in vertical pipes with upward flow direction

Installation in horizontal pipes

The sensor must be mounted as shown in the below figure. Do not mount the sensor as shown in the lower figure. This will position the electrodes at the top where there is possibility for air bubbles and at the bottom where there is possibility for mud, sludge, sand etc.

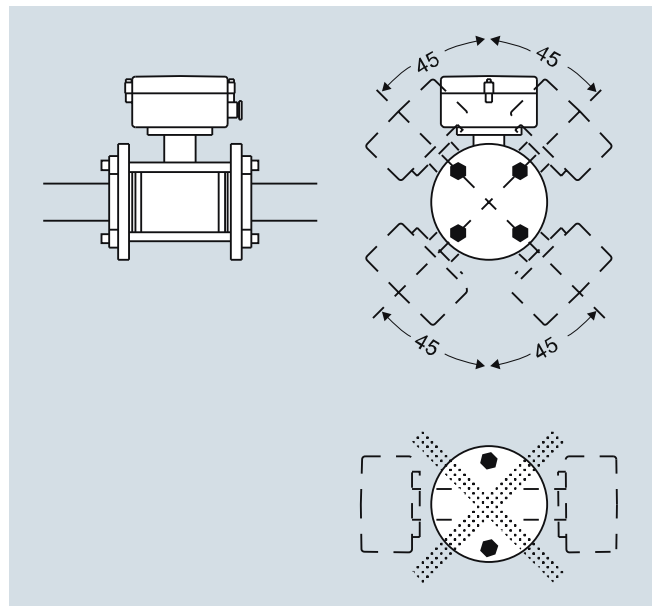


Flow Measurement

SITRANS F M

System information SITRANS F M Electromagnetic flowmeters


Measuring abrasive liquids and liquids containing particles

Recommended installation is in a vertical/inclined pipe to minimize the wear and deposits in the sensor.

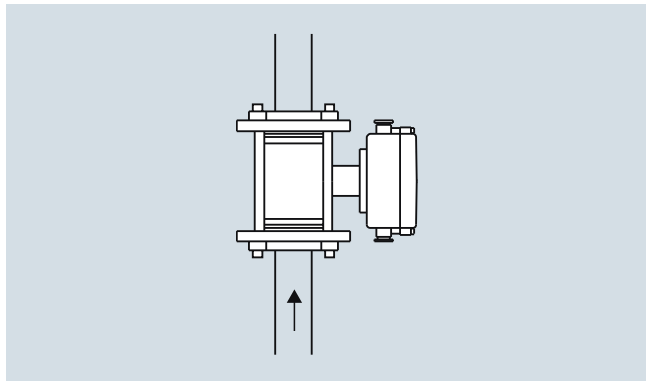

Install in vertical pipelines with upward flow direction if measuring abrasive liquids

Inlet and outlet conditions

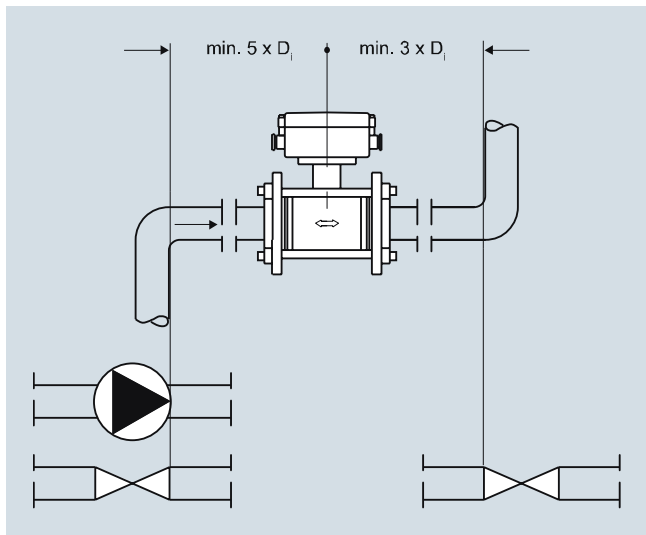

Recommended straight pipe lengths up and downstream for installations between elbows, pumps and valves.


To achieve maximum accurate flow measurement it is essential to have straight pipe lengths up and downstream. Practical experience has proved that the MAG 5100 W and MAG 8000 are capable to operate in non-optimal piping arrangements and still provide acceptable accuracy even with zero diameters upstream and downstream of straight run pipe.

It is also important to center the flowmeter in relation to pipe flange and gaskets.

Ambient temperature-Installation

Temperature changes can cause expansion or contraction in the pipe system. To avoid damage on the sensor use of proper gasket and torque should be ensured. For more information see sensor instruction.

Potential equalization

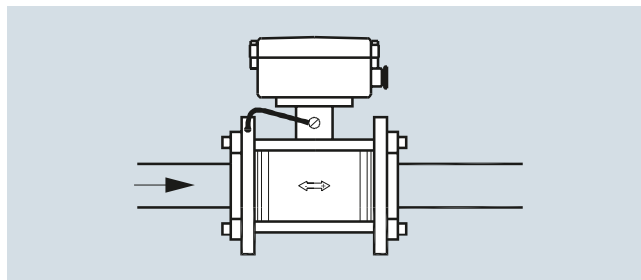


Potential equalization


The electrical potential of the liquid must always be equal to the electrical potential of the sensor. This can be achieved in different ways depending on the application:

- Wire jumper between sensor and adjacent flange (MAG 1100, MAG 3100)
- Direct metallic contact between sensor and fittings (MAG 1100 F)
- Built-in grounding electrodes (MAG 3100, MAG 5100 W)
- Optional grounding/protection flanges/rings (MAG 1100, MAG 3100, MAG 8000)
- Optional graphite gaskets on MAG 1100 (standard for MAG 1100 High Temperature)
- MAG 8000 installed in plastic or coated pipes: two grounding rings to be used.


Grounding

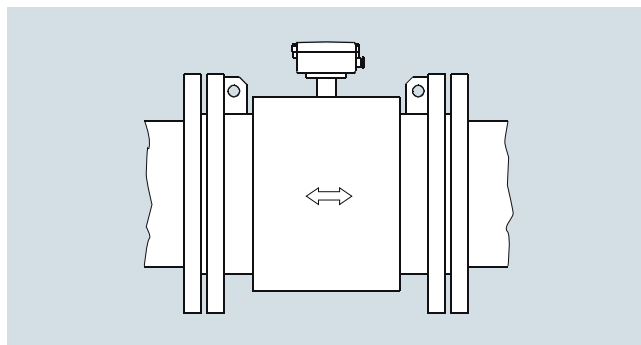

MAG 3100 and MAG 5100 W: with grounding electrodes in conductive and non-conductive pipes (no further action necessary)

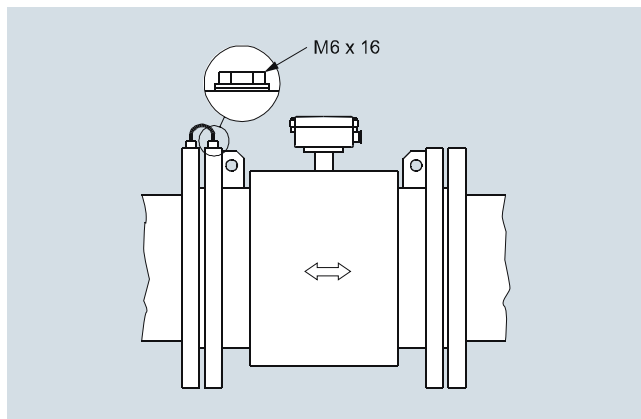


MAG 1100 and MAG 3100: without grounding electrodes in conductive pipes (MAG 1100 use graphite gasket)

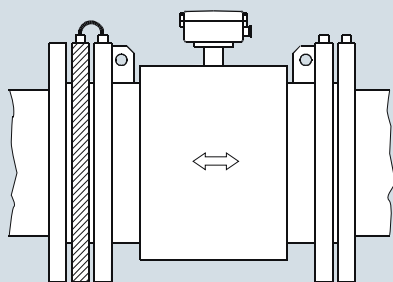

Without grounding electrodes in non-conductive pipes use grounding ring (MAG 1100 use graphite gasket)


MAG 1100 F grounding via process connections. MAG 8000 grounding see MAG 8000 pages.

Vacuum

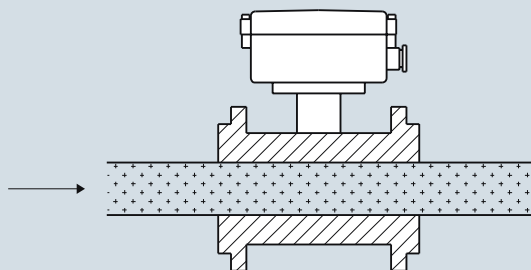


In order to prevent damages of liner when operating meters under vacuum please take note of the information "Operating pressure" given in section "Technical specification".

Installation in large pipes

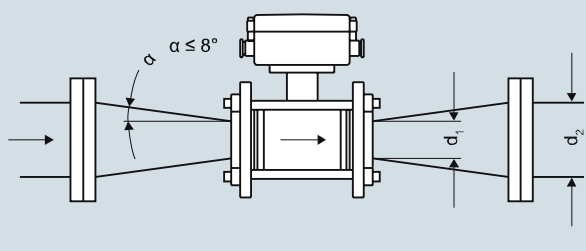

Reduction in nominal pipe diameter

The flowmeter can be installed between two reducers (e.g. DIN 28545). Assuming that at 8° the following pressure drop curve applies. The curves are applicable to water.

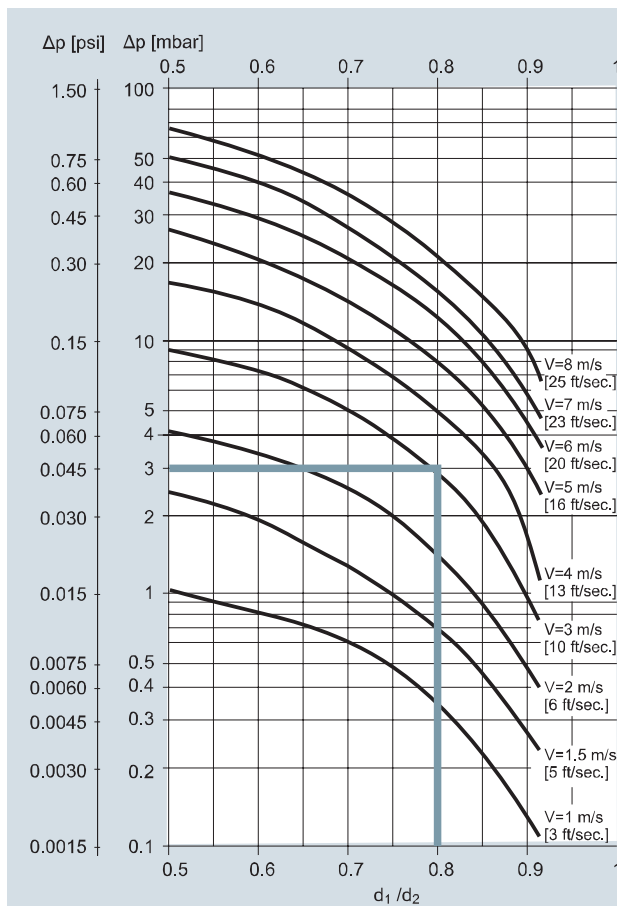


Pressure drop as function of diameter reduction between reducers

Example:

Flow velocity (v) of 3 m/s (10 ft/s) in a sensor with a diameter reduction DN 100 (4") to DN 80 (3") ($d_1/d_2 = 0.8$) gives a pressure drop of 2.9 mbar (0.04 psi).

Ambient temperature

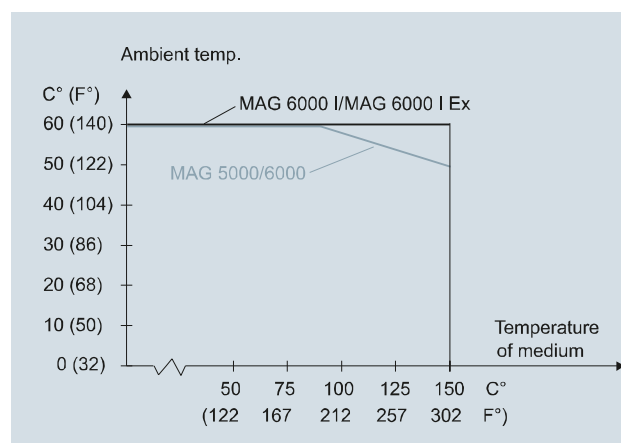

Max. ambient temperature as a function of temperature of medium

The transmitter can be installed either compact or remote.

With compact installation the temperature of medium must be according to the graph.

Flow Measurement


SITRANS F M

System information SITRANS F M Electromagnetic flowmeters

Sensor cables and conductivity of medium

Compact installation:

Liquids with an electrical conductivity $\geq 5 \mu\text{S/cm}$.

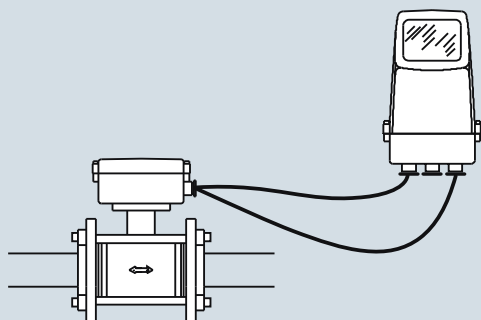

Remote installation

Empty pipe detection

The installation has to fulfill the following limitations for usage of the empty pipe detection function:


- media conductivity $\geq 20 \mu\text{S/cm}$
- length of cable at remote installation $\leq 50 \text{ m}$ (150 ft)
- special shield cable must be used

Note for MAG 1100 sizes DN 2 and DN 3:


- empty pipe detection is not available
- the media conductivity must be $\geq 30 \mu\text{S/cm}$

Note for MAG 5000/6000 CT:

- empty pipe detection is not available

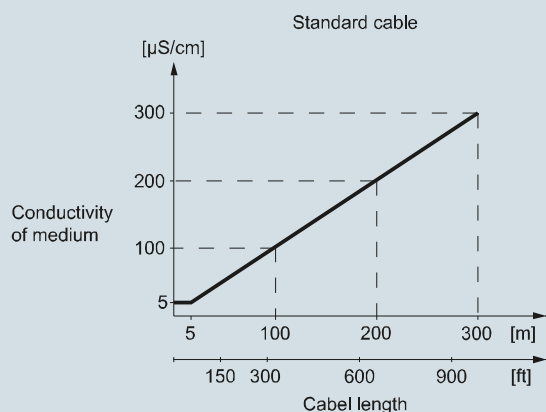

Minimum conductivity of medium (using standard electrode cable)

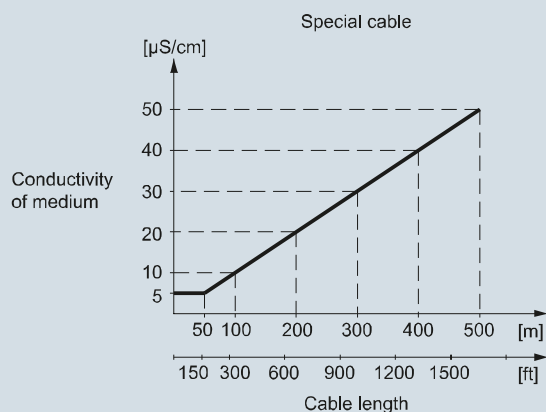

Minimum conductivity of medium (using special electrode cable)

Function

All electromagnetic flowmeters are based on Faraday's law of induction:

$$U_M = B \cdot v \cdot d \cdot k$$


U_M = Measured voltage induced in the medium perpendicular to the magnetic field and the flow direction. The voltage is tapped at two point electrodes.

B = Magnetic flux density which permeates the flowing medium perpendicular to the flow direction.

v = flow velocity of medium

d = internal diameter of metering tube

k = proportionality factor or sensor constant

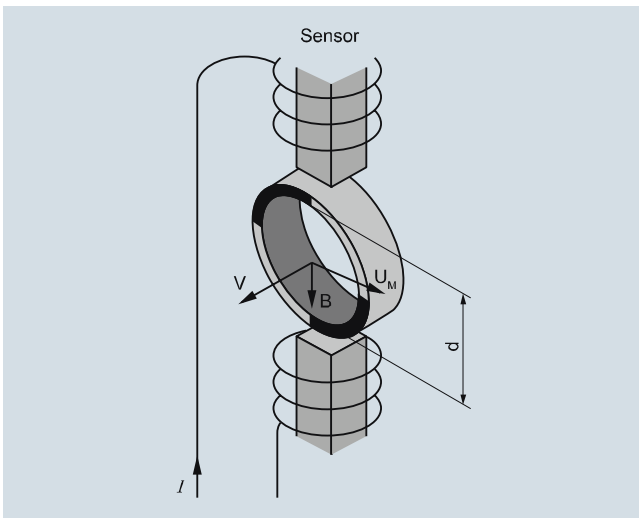

Function and measuring principle of electromagnetic measurement

An electromagnetic flowmeter generally consists of a magnetically non-conducting metering tube with an internal electrically non-conducting surface, magnet coils connected in series and mounted diametrically on the tube, and at least two electrodes which are inserted through the pipe wall and are in contact with the measured medium. The magnet field coils through which the current passes generate a pulsed electromagnetic field with the magnetic flux density B perpendicular to the pipe axis.

This magnetic field penetrates the magnetically non-conducting metering tube and the medium flowing through it, which must have a minimum electrical conductivity.

According to Faraday's law of induction, a voltage U_M is generated in an electrically conducting medium, and is proportional to the flow velocity v of the medium, the magnetic flux density B , and the distance between the electrodes d (internal diameter of pipe).

The signal voltage U_M is tapped by the electrodes which are in contact with the medium, and passed through the insulating pipe wall. The signal voltage U_M which is proportional to the flow velocity is converted by an associated transmitter into appropriate standard signals such as 4 to 20 mA.

SITRANS F M diagnostics

The diagnostic functions are all internal tools in the meter:

- Identification in clear text and error log
- Error categories: function; warning; permanent and fatal errors
- Transmitter self-check including all outputs and the accuracy
- Sensor check: coil and electrode circuit test
- Overflow
- Empty pipe: partial filling; low conductivity; electrode fouling

SITRANS F M Verificator (MAG 5000 and 6000)

The SITRANS F M Verificator is an external tool designed for MAG 5000 and MAG 6000 with MAG 1100, MAG 1100 F, MAG 3100, MAG 3100 P or MAG 5100 W sensors to verify the entire product, the installation and the application.

The goal is to improve operation, reduce downtime and maintain measurement accuracy as long as possible.

The SITRANS F M Verificator is highly advanced and carries out the complex verification and performance check of the entire flowmeter system, according to unique Siemens patented principles. The whole verification test is automated and easy to operate so there is no opportunity for human error or influence. The system is traceable to international standards and tested by WRc (Water Research Council).



SITRANS F M Verificator

- Stand alone Verificator to measure a number of selected parameters in the flow sensor and a transmitter which affects the integrity of the flow measurement
- Up to 20 measurements can be stored in the Verificator
- The Verificator can be connected via a serial cable to a PC enabling download of the data. A Windows program enables printing and management of vericator reports.

Verification - Steps

Verification of a SITRANS F M flowmeter consists of the following test routines:

1. Transmitter test
2. Flowmeter and cable insulation test
3. Sensor magnetism test


Flow Measurement

SITRANS F M

SITRANS F M Verificator

1. Transmitter test

The transmitter test is the traditional way of on-site testing on the market and checks the complete electronic system from signal input to output.

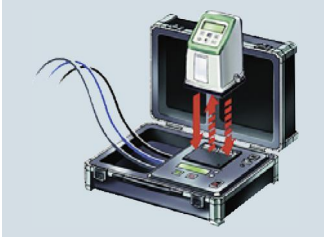


Transmitter test

Using the excitation power output, which is generated to drive the magnetic field of the sensor, the verificator simulates flow signal to the transmitter input. By measuring the transmitter output the verificator calculates its accuracy against defined values. Test includes:

- Excitation power to drive the magnetic field
- Signal function from signal input to output
- Signal processing – gain, offset and linearity
- Test of analogue and frequency output

2. Insulation test

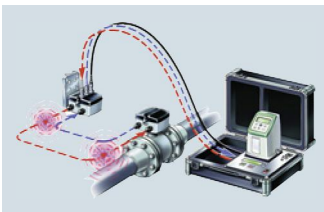


Flowmeter insulation test

The verification test of the flowmeter insulation is a „cross talk“ test of the entire flowmeter which ensures that the flow signal generated in the sensor is not affected by any external influences.

In the "cross-talk" test the verificator generates a high voltage disturbance within the coil circuit and then looks for any "cross-talk" induced in the flow signal circuit. By generating dynamic disturbances close-coupled to the flow signal, the flowmeter is tested for noise immunity to a maximum level:

- EMC influence on the flow signal
- Moisture in sensor, connection and terminal box
- Non-conductive deposit coating the electrodes within the sensor
- Missing or poor grounding, shielding and cable connection.

3. Sensor magnetism test

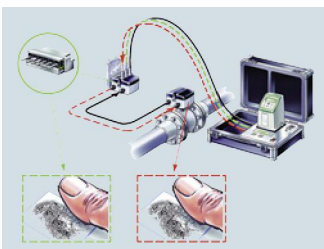

Sensor magnetism test

The verification of the sensor magnetism is a "boost" test of the magnetic field coil. The test ensures that the magnetism behaviour is like the first time, by comparing the current sensor magnetism with the "fingerprint" which was determined during initial calibration and stored in the SENSORPROM memory unit. In the "boost" test the verificator changes the magnetic field in certain pattern and with high voltage to get quick stable magnetic condition. This unique test is fulfilled without any interference or compensation of surrounding temperature or interconnecting cabling.

- Changes in dynamic magnetic behaviour
- Magnetic influence inside and outside the sensor
- Missing or poor coil wire and cable connection

Certificate

The test certificate generated by a PC contains:

- Test result with passed or failed
- Installation specification
- Flowmeter specification and configuration
- Verificator specification with date of calibration ensuring traceability to international standards.

MAGFLO® Verification Certificate							
Customer:				MAGFLO® Identification:			
Name _____				TAG No./Name 0			
Address _____				Sensor Code No. ZME634			
Phone _____				Sensor Serial No. 057701H142			
Email _____				Transmitter Code No. ZME692			
				Transmitter Serial No. 109418N080			
				Location _____			
Results:							
Verification file name or No. FT-103FT2801							
Transmitter Passed							
Sensor Insulation Passed							
Magnetic Circuit Passed							
Velocity		Current Output		Frequency Output			
Theoretical	Theoretical	Actual	Deviation	Theoretical	Actual	Deviation	
0.5m/s	4.800mA	4.802mA	0.25%	0.500kHz	0.501kHz	0.11%	
1.0m/s	5.600mA	5.601mA	0.08%	1.000kHz	1.001kHz	0.07%	
3.0m/s	8.800mA	8.804mA	0.08%	3.000kHz	3.004kHz	0.14%	
Current Output 4-20mA				Frequency Output 0-10kHz			
Transmitter Settings:				Sensor Details:			
Basic Qmax. 2.00000 m³/h				Size DN 15 1/2 IN			
Flow Direction Positive				Cal. Factor 0.16531426			
Low flow Cut-off 1.50%				Correction Factor 1.0			
Empty Pipe ON				Excitation Freq. 12.5Hz			
Output Current Output ON (4-20mA)							
Time Constant 5.0 Sec.							
Relay Output Error Level							
Digital Output Pulse							
Frequency Range N/A							
Time Constant N/A							
Volume/pulse 1.0 l/p							
Pulse width 0.51999998 sec.							
Pulse polarity Positiv							
Totalizer 1 value before test 819442.93213 l				Verificator Details (083F5060)			
Totalizer 1 value after test 819458.92334 l				Serial No. 107920N460			
Totalizer 2 value before test 693.87579 l				Device No. 94683			
Totalizer 2 value after test 693.88145 l				Software Version 1.40			
Operating time in days 1068				PC-Software Version 5.01			
				Cal. date 2015.10.26			
				ReCal. date 2016.10.26			
Comments							
These tests verify that the flowmeter is functioning within 2% deviation of the original test parameters.							
Verification is traceable to National and International Standards.							
Date and signature _____							
2016.10.26							

Description

SITRANS F M Verificator

- 11 ... 30 V DC, 11 ... 24 V AC, 115 ... 230 V, 50 Hz
- 11 ... 30 V DC, 11 ... 24 V AC, 115 ... 230 V, 60 Hz

Article No.

FDK:083F5060

FDK:083F5061

Note:

It is mandatory to have the Verificator returned to the factory once a year for check and re-verification.