

Product Update

Proof of Chemical Delivery Systems v1.0


Be rest assured your pump is physically dosing product



Wire-less remote communication device can SMS and/or e-mail a pump fault

Operation:

1. Pump doses chemical to EMEC SEFL dose monitoring device
Red lamp on SEFL indicates dosing
2. Pulse cable plugs into front of Remote communication device
3. Dosing is monitored, and upon a fault, an SMS and/or e-mail is sent

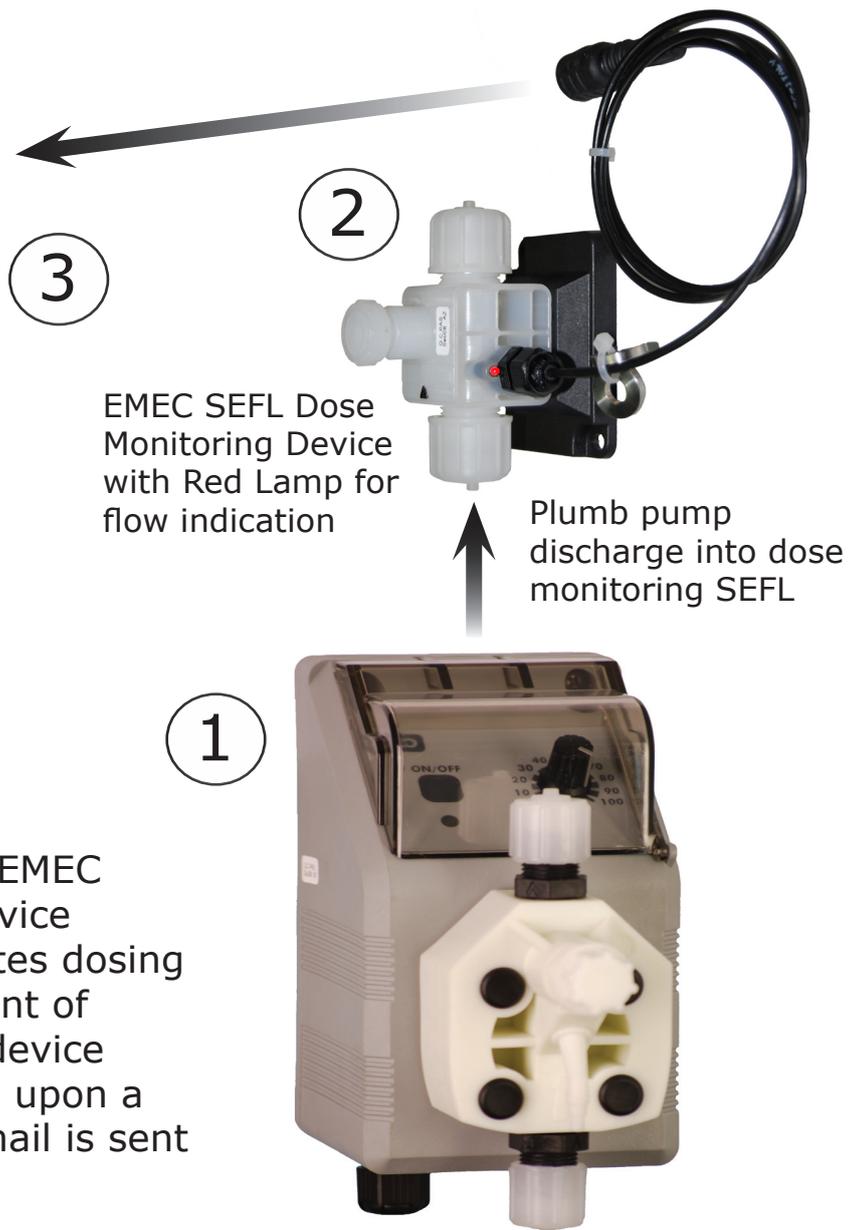

EMEC SEFL Dose Monitoring Device with Red Lamp for flow indication

Plumb pump discharge into dose monitoring SEFL

For more info visit our website link:

http://www.cwc.com.au/products/mp_emec_acc_flowmon.html