



TOTAL MASS(kg) 6.98 kgs.	TOLERANCES: - UNLESS NOTED OTHERWISE LINEAR +/- 0.5 DIAMETER +/- 0.25 ANGULAR +/- 0.5°	ISS	ECN No.	DESCRIPTION OF CHANGE	DATE	BY	APPD
 3rd ANGLE PROJECTION		2	5385	leg length changed to 300	13.08.07	J.Que	-
		3	5601	all toe nipples changed to STD size	06.06.08	J.Que	-
		4	5678	overflow dimensions altered	27.08.09	B.Gib	-
ALL DIMENSIONS ARE IN mm UNLESS OTHERWISE SPECIFIED							

DO NOT SCALE FROM DRAWING, WHEN IN DOUBT ASK!

REMOVE ALL BURRS & SHARP EDGES.

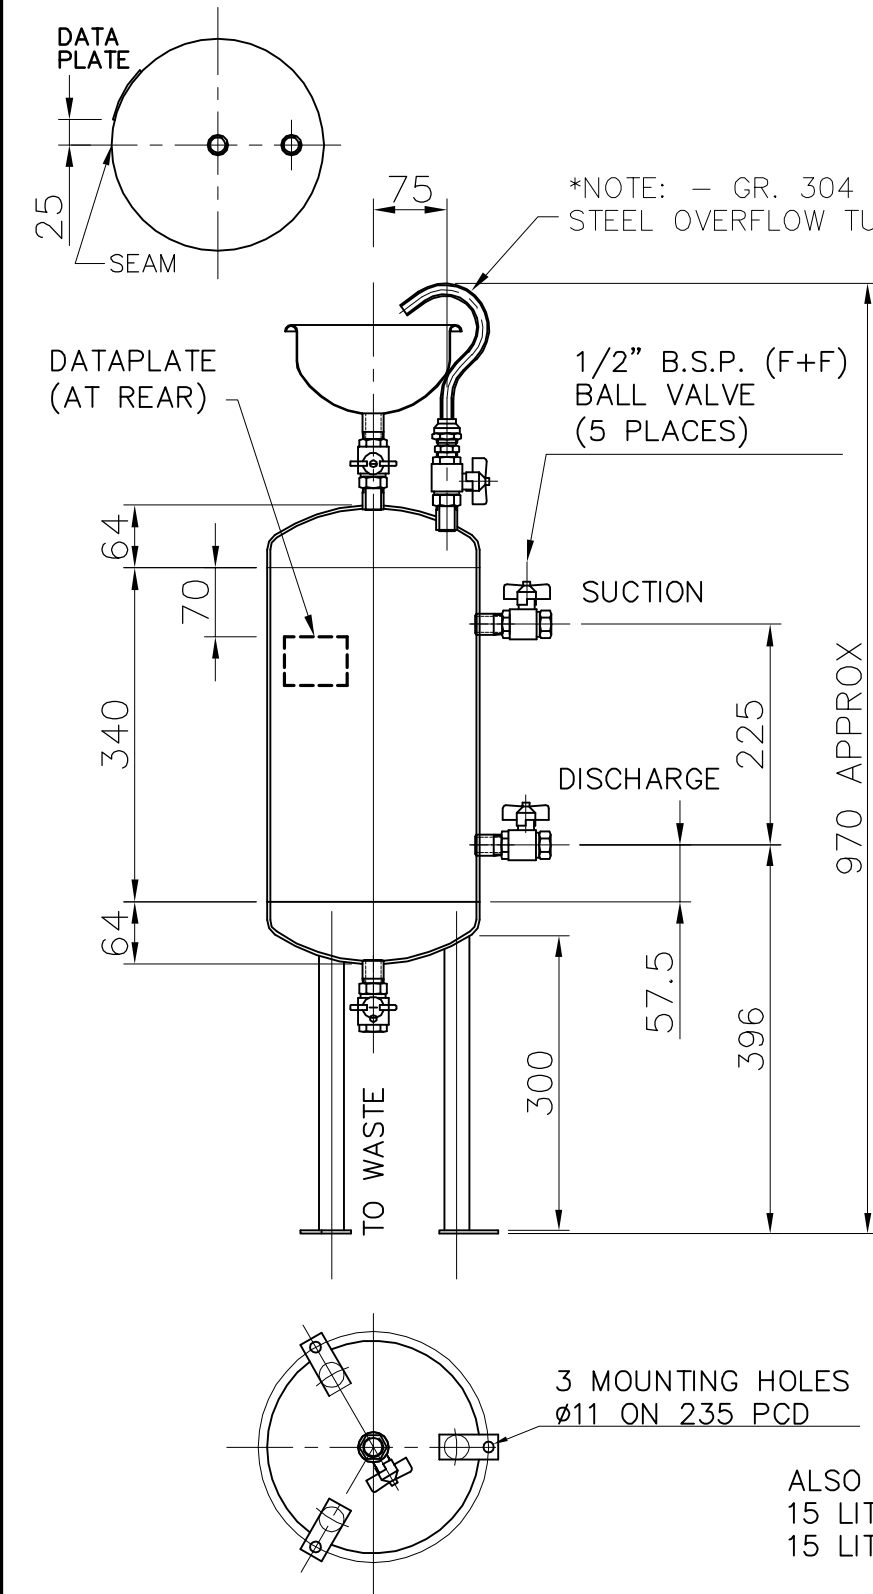

DATA
CODE: AS1210 - 1997
DESIGN PRESSURE:
DESIGN TEMPERATURE:
CORROSION ALLOWANCE:
RADIOGRAPHY:
POSTWELD HEAT TREATMENT:
HYDROSTATIC TEST PRESSURE:

CLASS 3
1000 kPag
99°C
0 mm
NIL
NIL
1500 kPag

MATERIALS
SHELL:
DISHED ENDS
NIPPLES:
LEGS & FEET:
VALVES:
OVERFLOW:

ASTM A240 - 304
ASTM A240 - 304
304 SS
304 SS
NICKEL PLATED BRASS
304 SS

DESIGN PRESSURE	1.0 MPa @ 99°C
TEST PRESSURE	1.5 MPa
DESIGN CODE	AS 1210 CLASS 3
HAZARD LEVEL	E
DATE TESTED	MM/YY

ALSO REFERRED TO AS:
15 LITRE BY-PASS FEEDER.
15 LITRE SLUG TANK.

UNCONTROLLED DOCUMENT (EXTERNAL TO STPV) UNLESS STATED OTHERWISE								
DRAWN B.Gib	DATE 17.07.06	APP'D.	DATE	TITLE 15 LITRE DOSING POT		CAD FILE No. G:\216 dia		
MATERIAL ASTM A240 GR.304 STAINLESS STEEL			TANK VOLUME 15 litres			SCALE NTS		
			PART No. DPA0615			ISSUE 4		
SURFACE TREATMENT NATURAL								